

El analizador de vibraciones Fluke 810 facilita el seguimiento del estado de la máquina con el software Viewer para PC. El software Viewer incluido le ayuda a generar rápidamente informes en formato .PDF que incluyen información de configuración y diagnóstico de la correa de transmisión, así como de las copias de seguridad. El software también le permite dibujar un panorama más amplio cargando imágenes de sus máquinas (en formato .JPG o .IS2 de Fluke).

Este documento es una muestra de informe de diagnóstico del Fluke 810. El aspecto real del informe depende de los datos capturados y de las imágenes seleccionadas para su inclusión. Para obtener más información, visite www.fluke.com/viewer-software o envíe un mensaje de correo electrónico a vibration@fluke.com.

Date:10/12/2010 5:50 PM

810 Vibration Tester Diagnostic Report

Device Serial Number : VibrationTester1
 Machine Setup Name : USCC
 Measurement Date/Time : 05/18/2010 11:48:10


Drive Train



Diagnosis

Fault description	Fault severity	Severity Score	Severity Scale
Pump Free End Ball Bearing Wear	Moderate	31/100	
Pump Drive End Ball Bearing Wear	Moderate	30/100	
Pump Drive End Looseness Or Bearing Clearance Problem	Slight	8/100	


Image

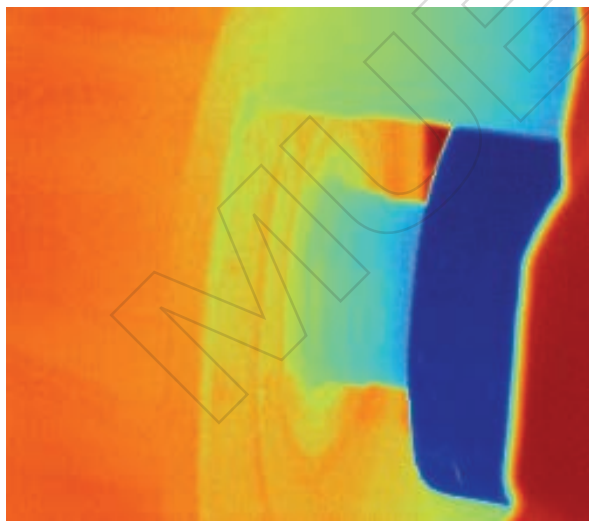


Recommendations

Recommendations	Priority	Priority Description
Monitor All Pump Bearings For Increased Vibration	2	Desirable


Location : Location 2
Range : High range
Axis : Axial
X Axis Unit : Orders
Y Axis Unit : mm/sec

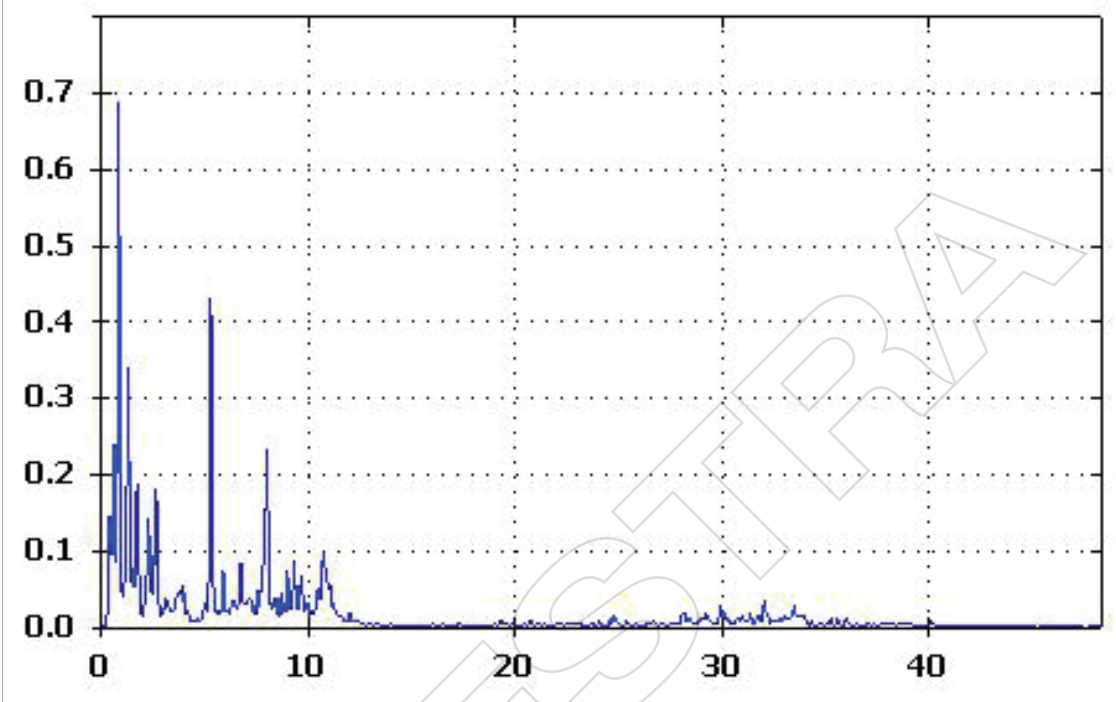


Location : Location 2
Range : Low range
Axis : Axial
X Axis Unit : Orders
Y Axis Unit : mm/sec

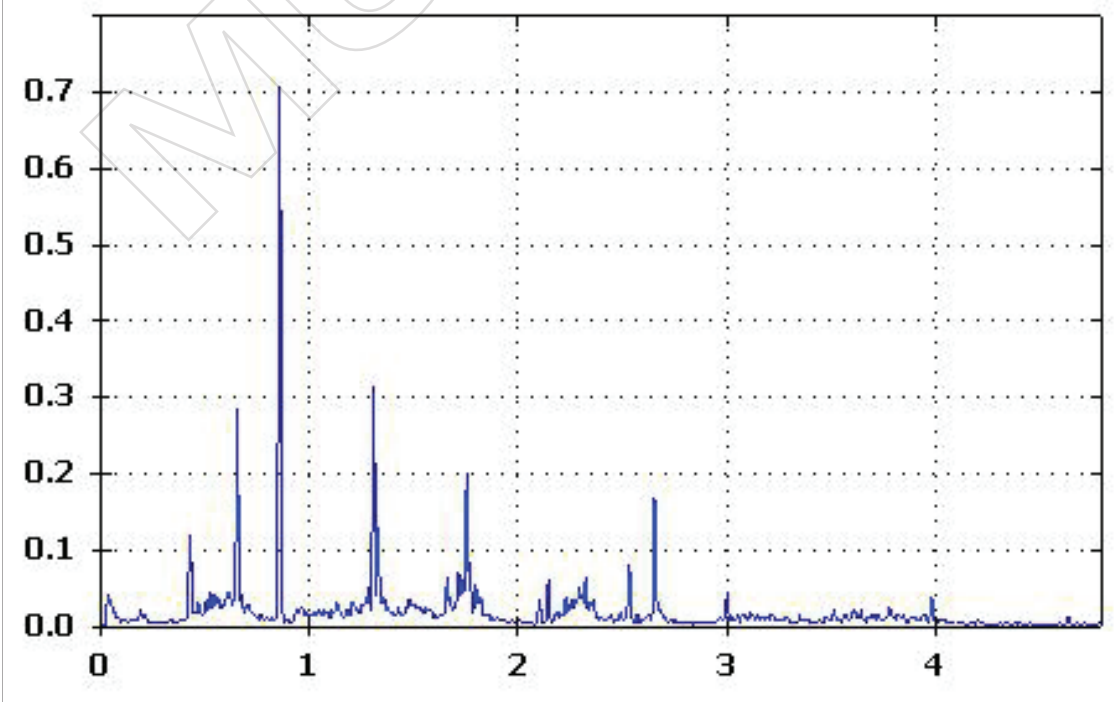


Location : Location 2
Range : High range
Axis : Tangential
X Axis Unit : Orders
Y Axis Unit : mm/sec

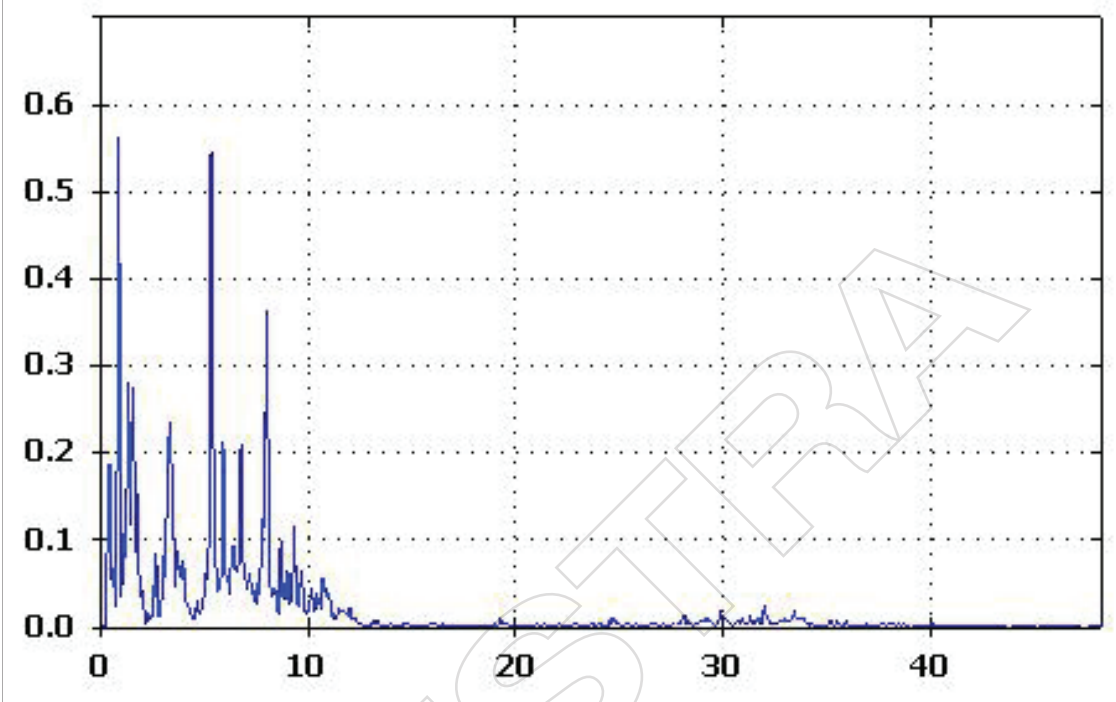


Location : Location 2
Range : Low range
Axis : Tangential
X Axis Unit : Orders
Y Axis Unit : mm/sec

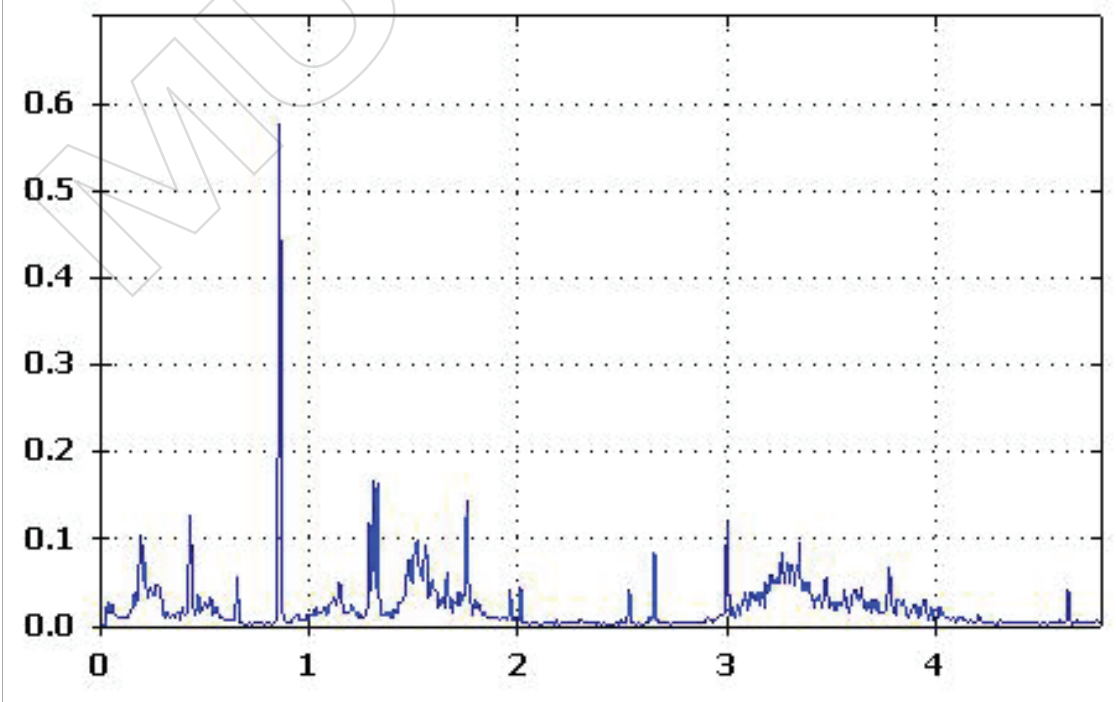


Location : Location 2
Range : High range
Axis : Radial
X Axis Unit : Orders
Y Axis Unit : mm/sec

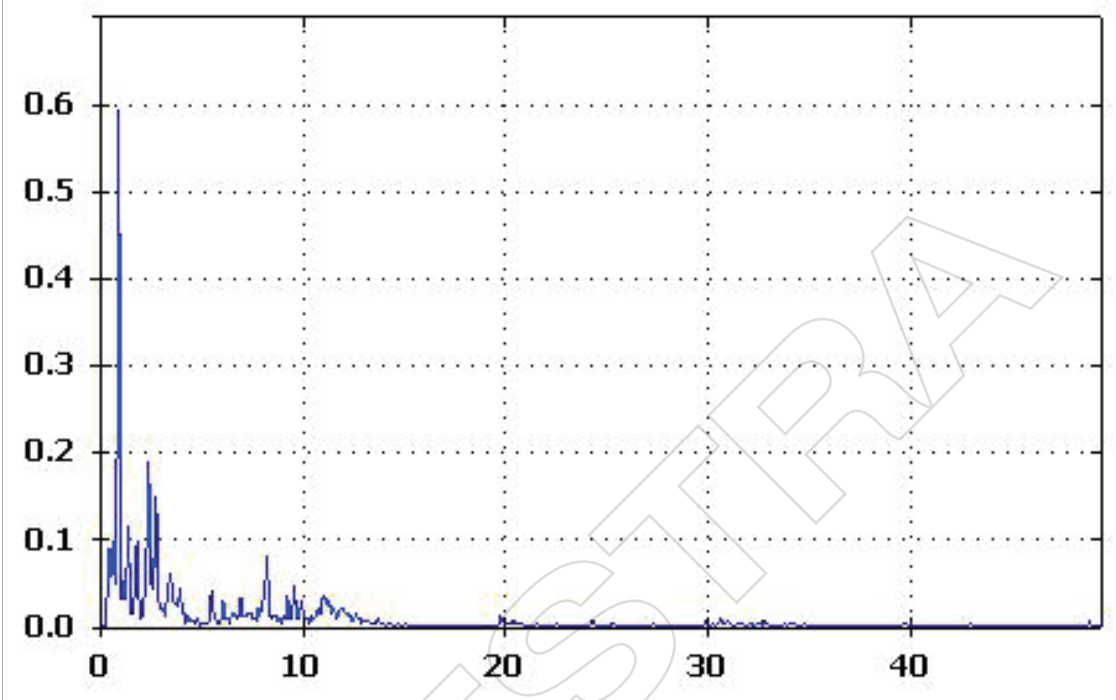


Location : Location 2
Range : Low range
Axis : Radial
X Axis Unit : Orders
Y Axis Unit : mm/sec

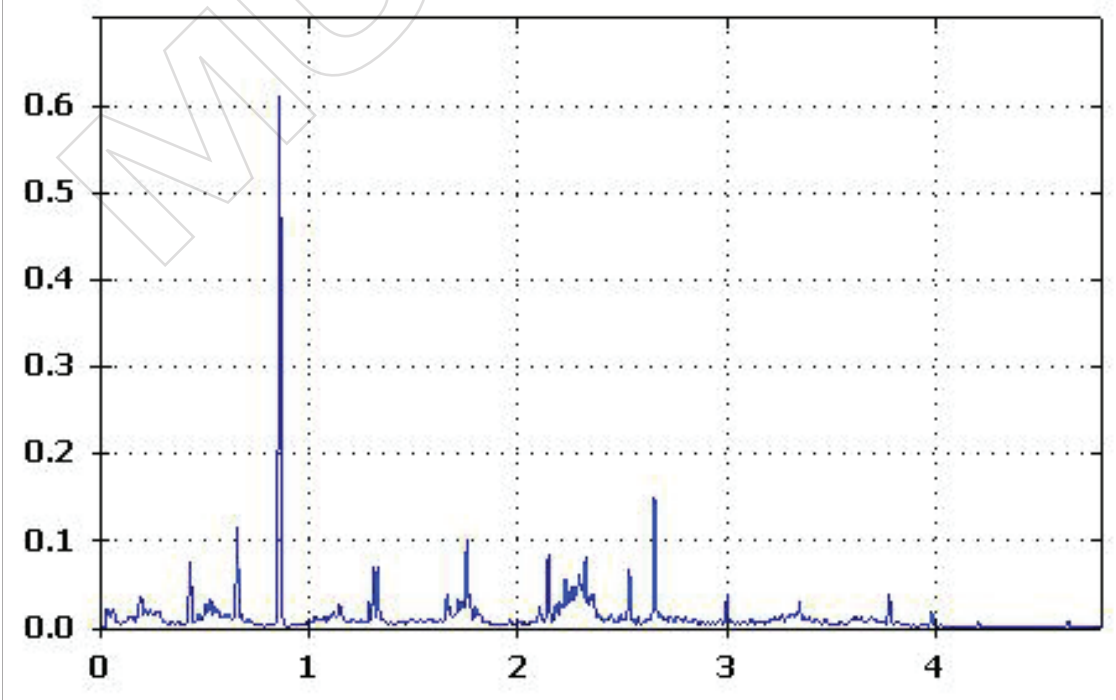


Location : Location 3
Range : High range
Axis : Axial
X Axis Unit : Orders
Y Axis Unit : mm/sec

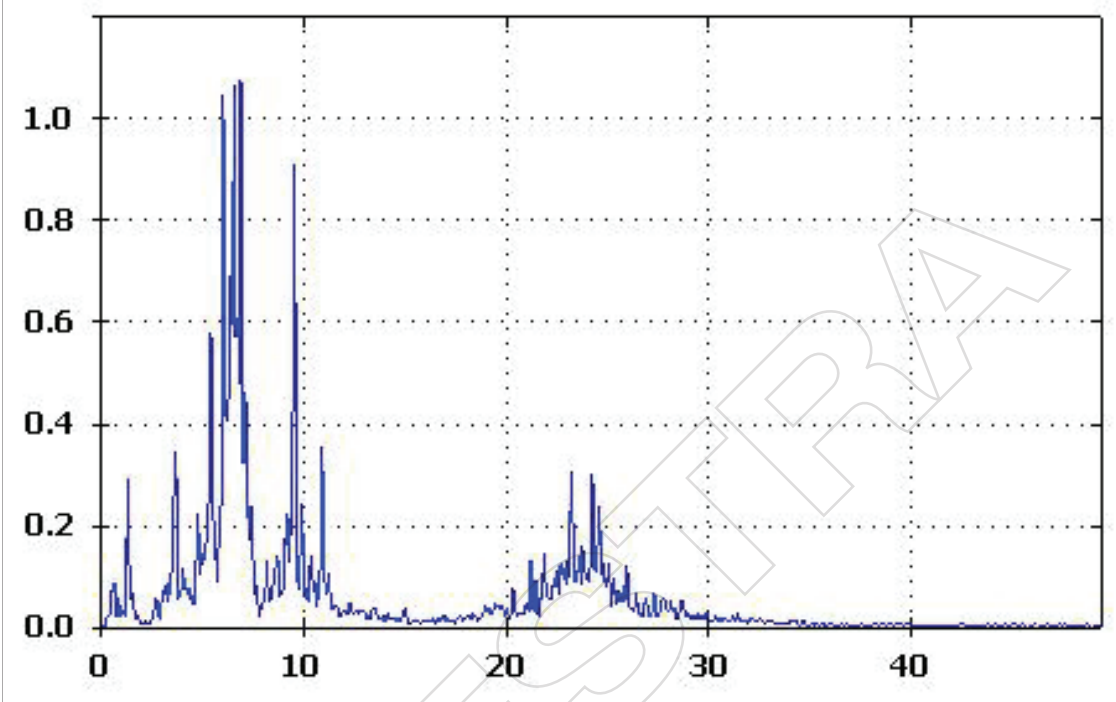


Location : Location 3
Range : Low range
Axis : Axial
X Axis Unit : Orders
Y Axis Unit : mm/sec

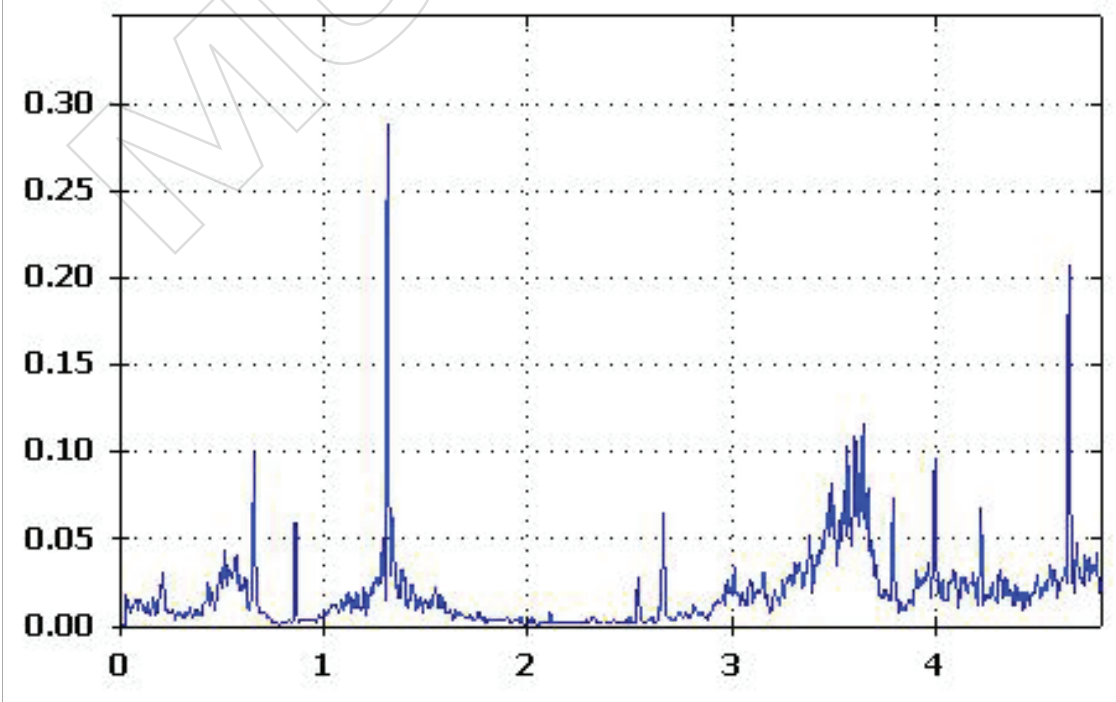


Location : Location 3
Range : High range
Axis : Tangential
X Axis Unit : Orders
Y Axis Unit : mm/sec

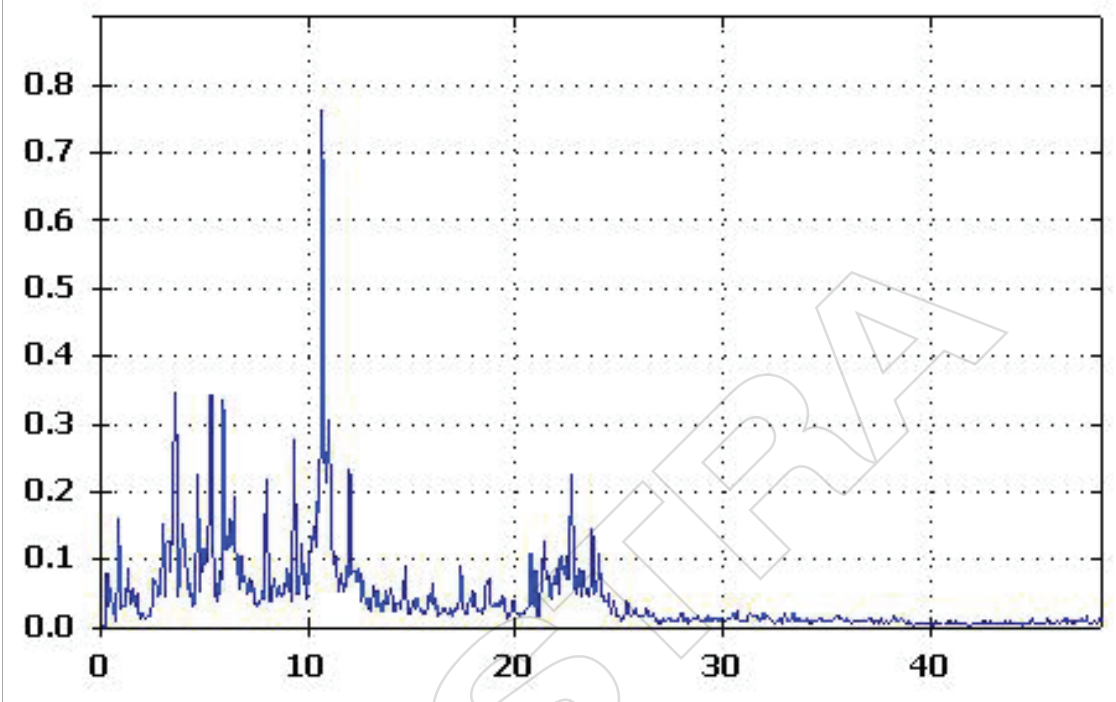


Location : Location 3
Range : Low range
Axis : Tangential
X Axis Unit : Orders
Y Axis Unit : mm/sec

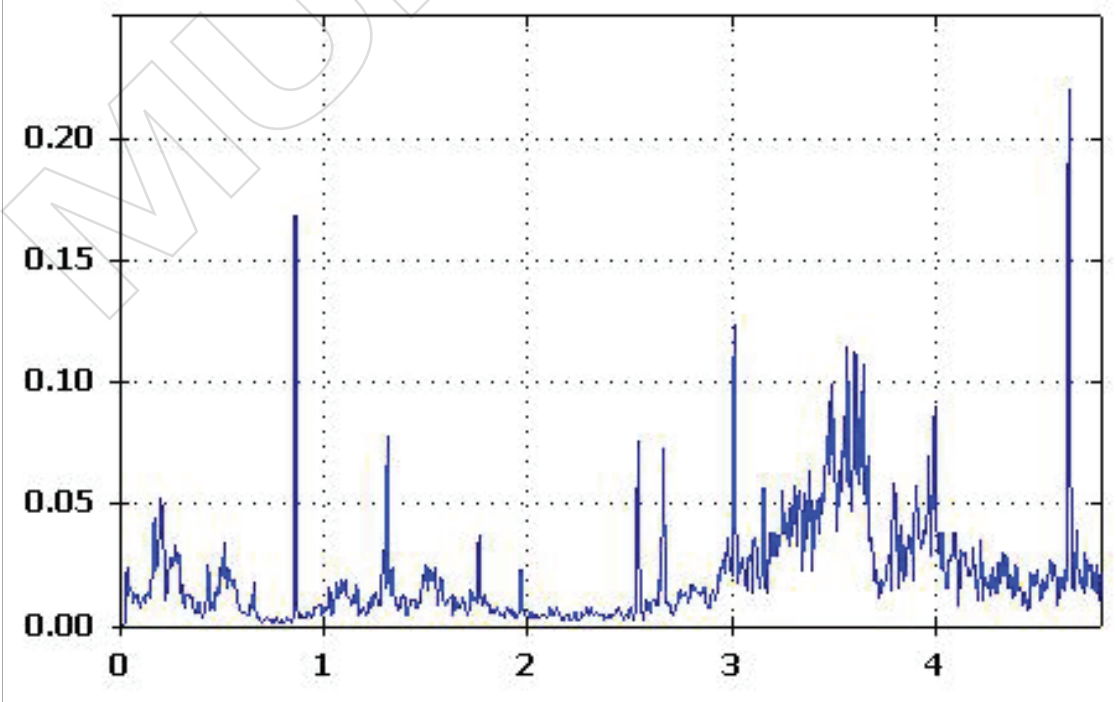


Location : Location 3
Range : High range
Axis : Radial
X Axis Unit : Orders
Y Axis Unit : mm/sec

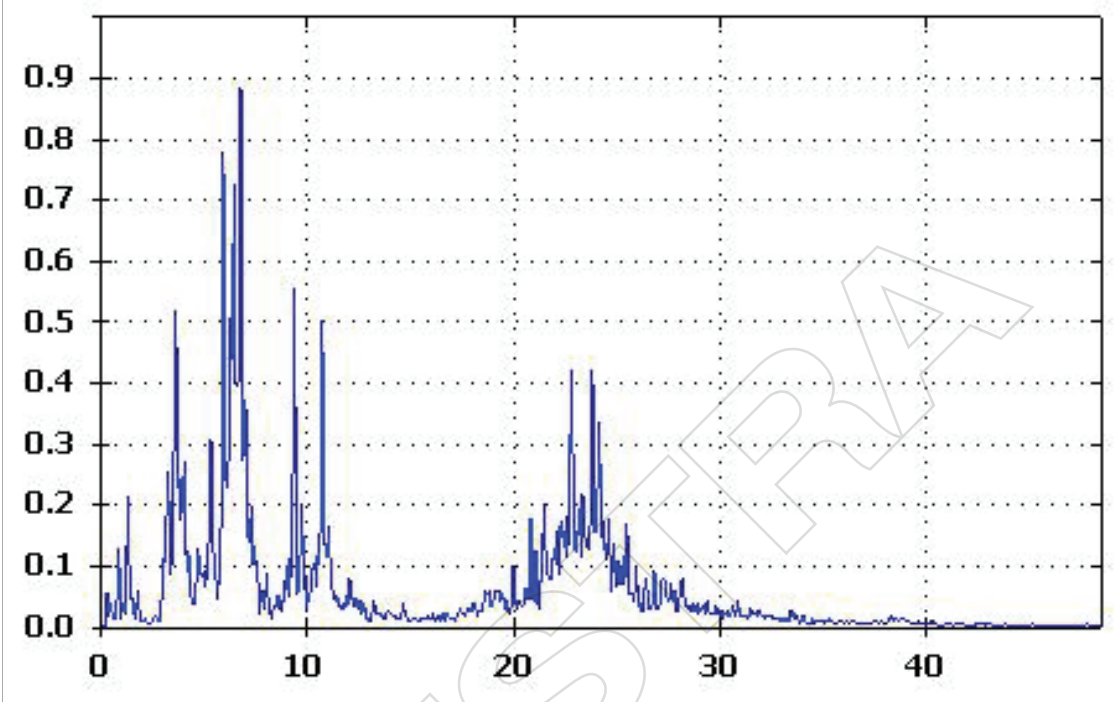


Location : Location 3
Range : Low range
Axis : Radial
X Axis Unit : Orders
Y Axis Unit : mm/sec

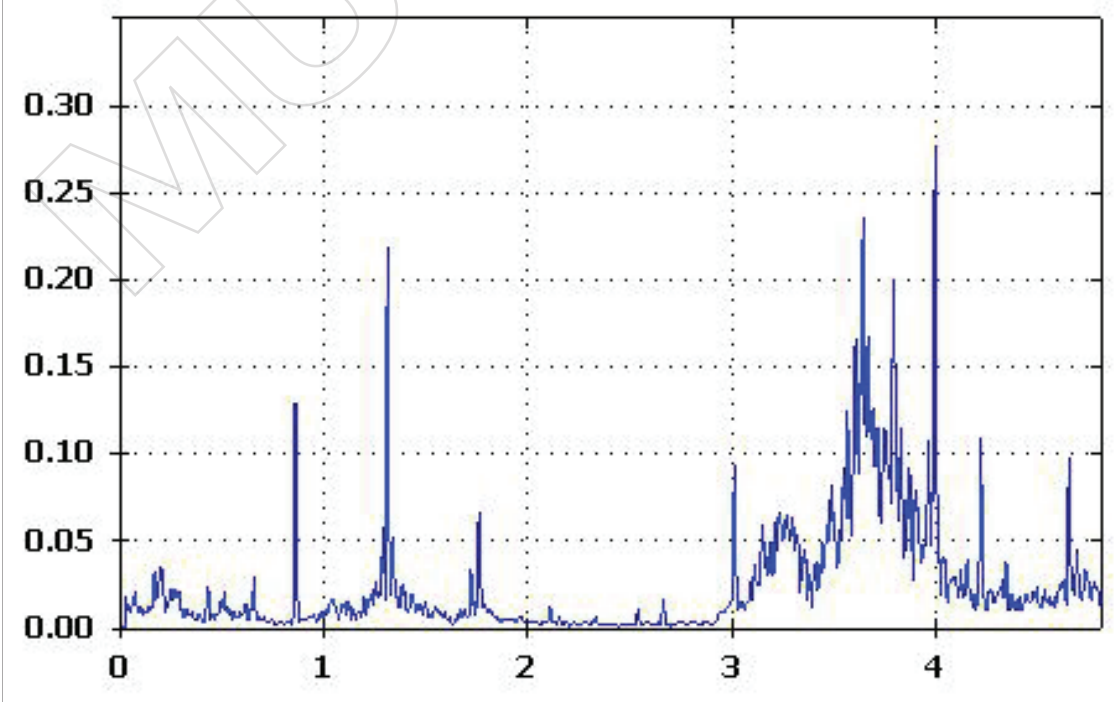


Location : Location 4
Range : High range
Axis : Axial
X Axis Unit : Orders
Y Axis Unit : mm/sec

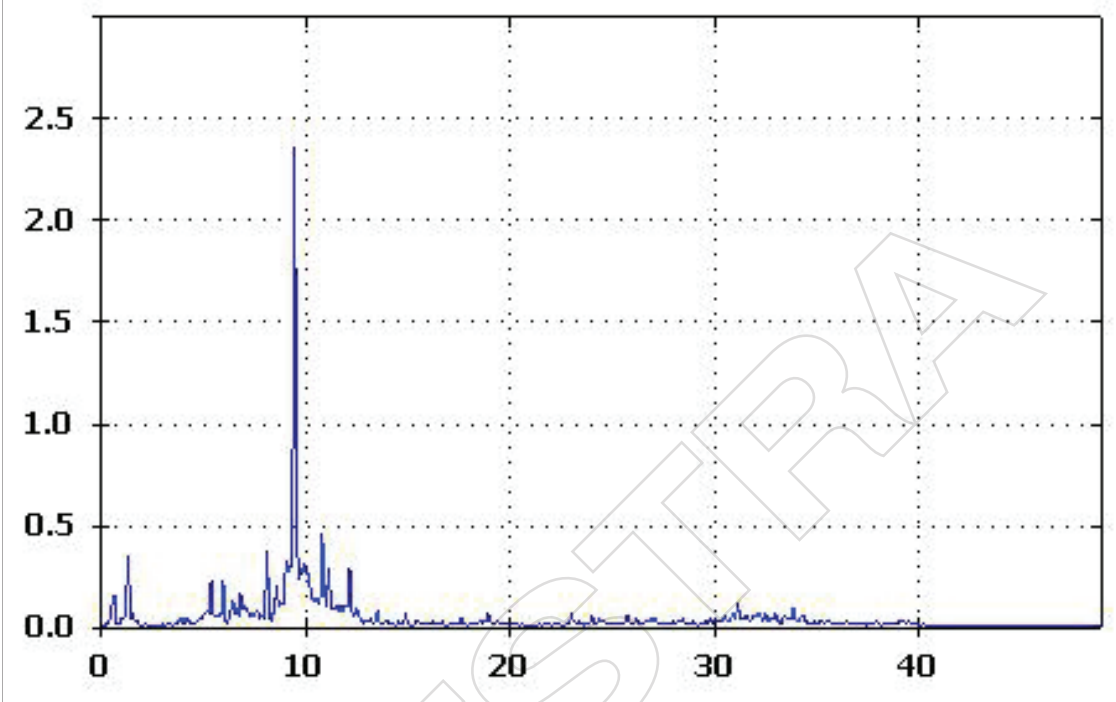


Location : Location 4
Range : Low range
Axis : Axial
X Axis Unit : Orders
Y Axis Unit : mm/sec

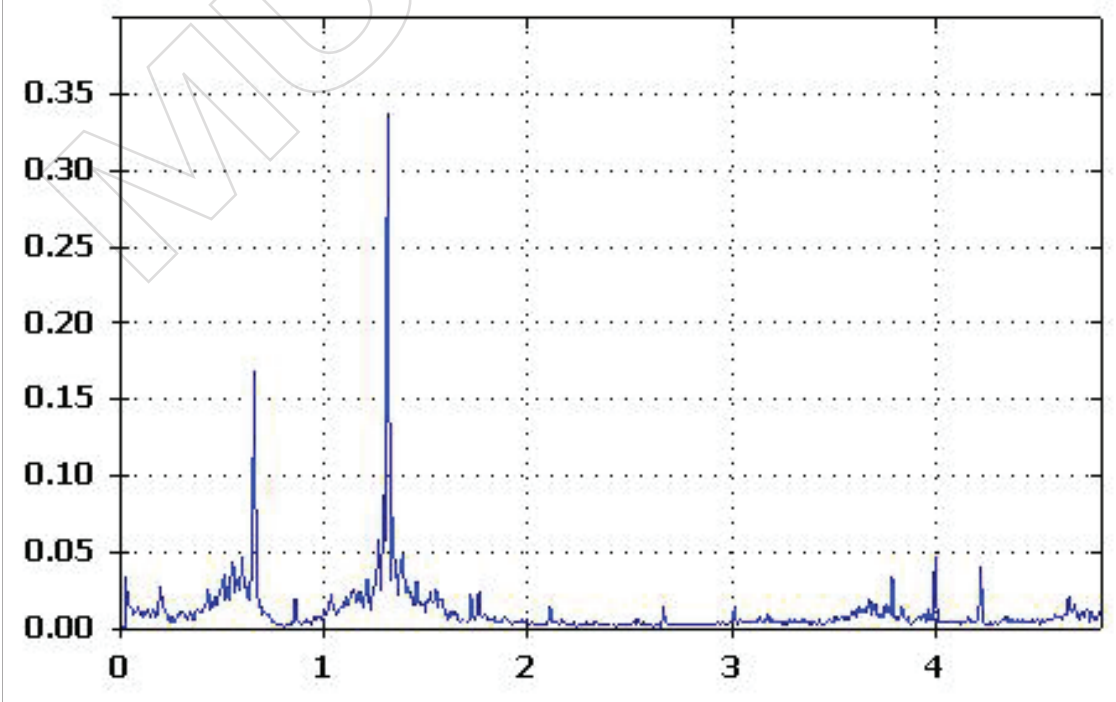


Location : Location 4
Range : High range
Axis : Axial
X Axis Unit : Orders
Y Axis Unit : mm/sec

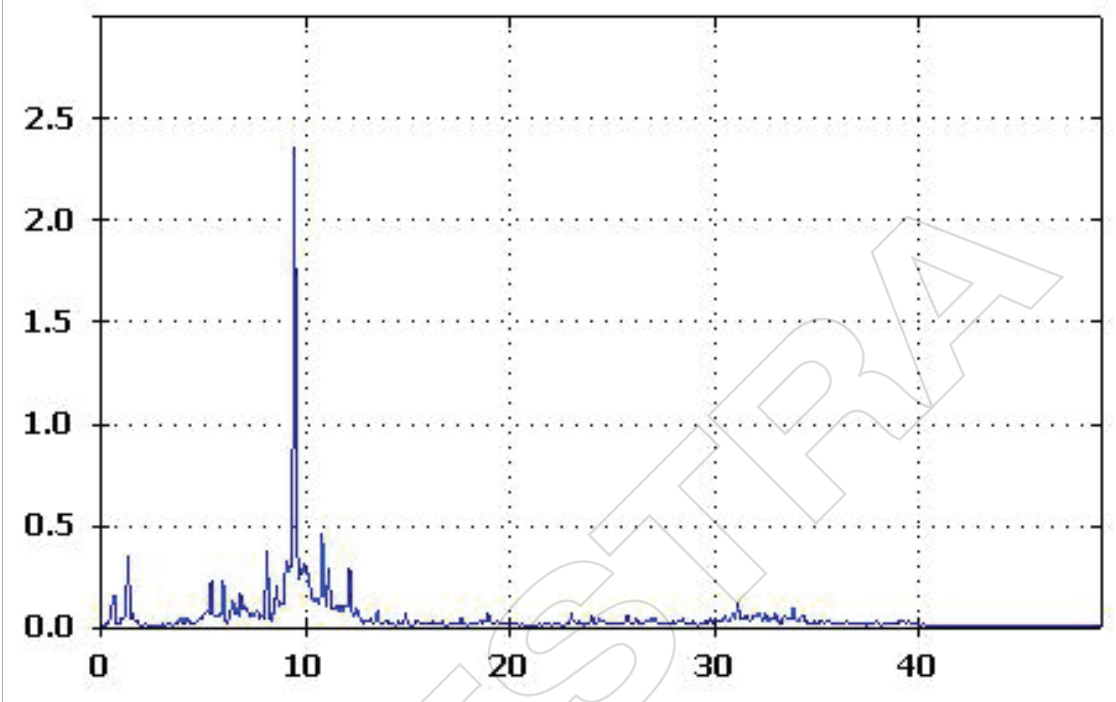


Location : Location 4
Range : Low range
Axis : Axial
X Axis Unit : Orders
Y Axis Unit : mm/sec

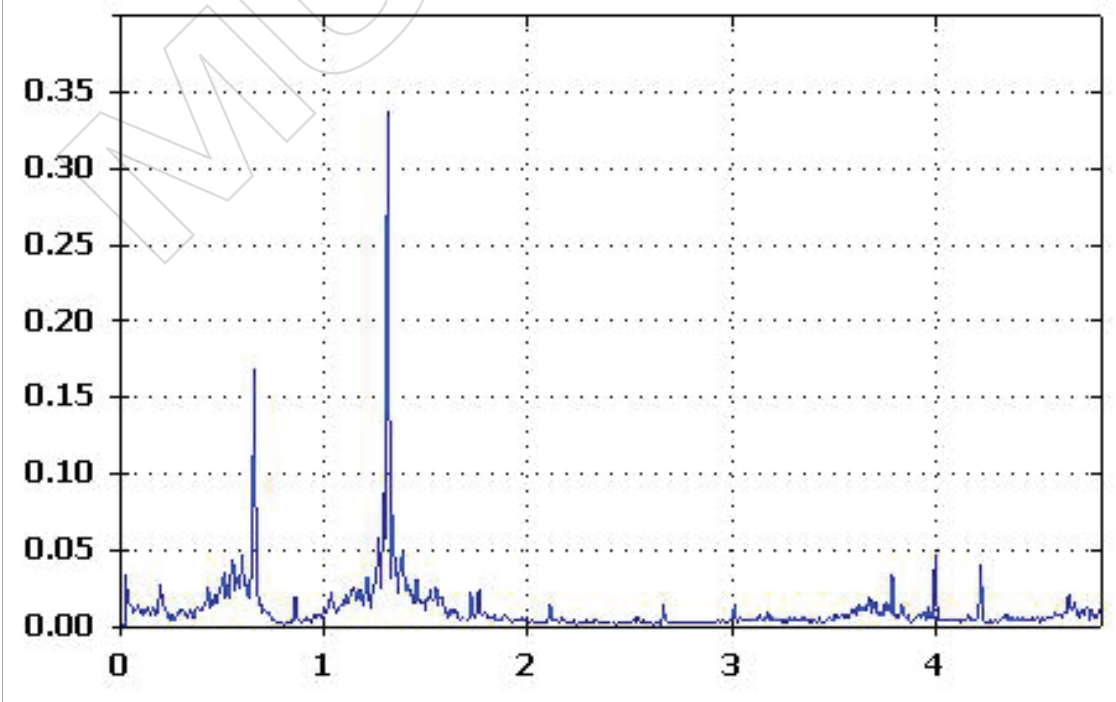

Location : Location 4
Range : High range
Axis : Radial
X Axis Unit : Orders
Y Axis Unit : mm/sec

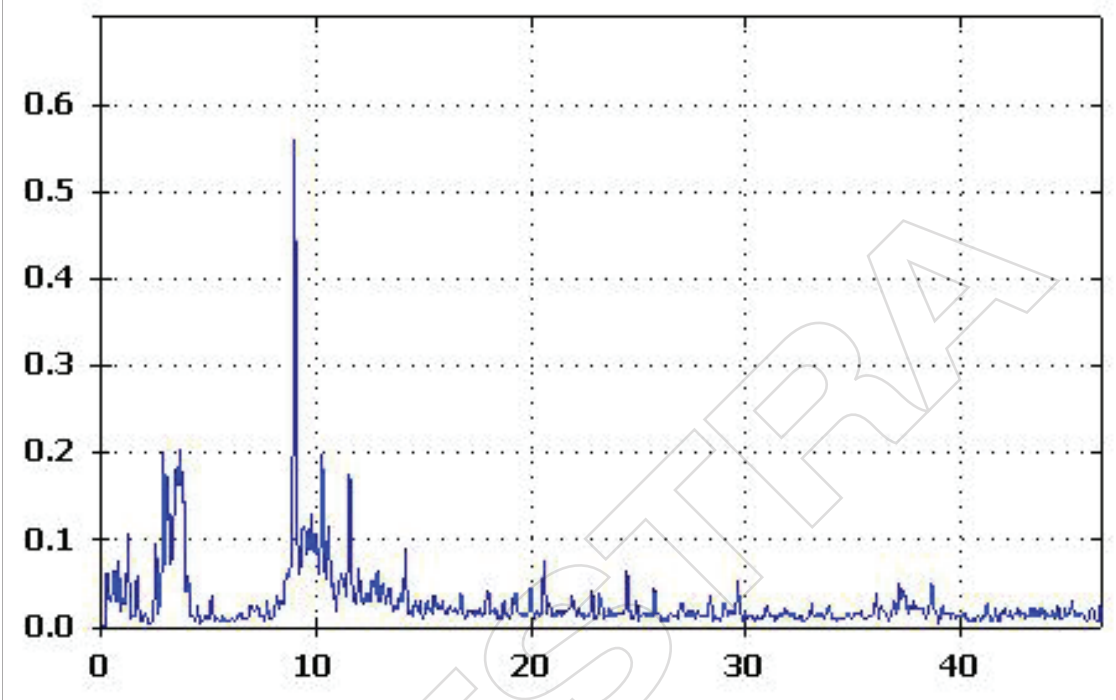

Location : Location 4
Range : Low range
Axis : Radial
X Axis Unit : Orders
Y Axis Unit : mm/sec

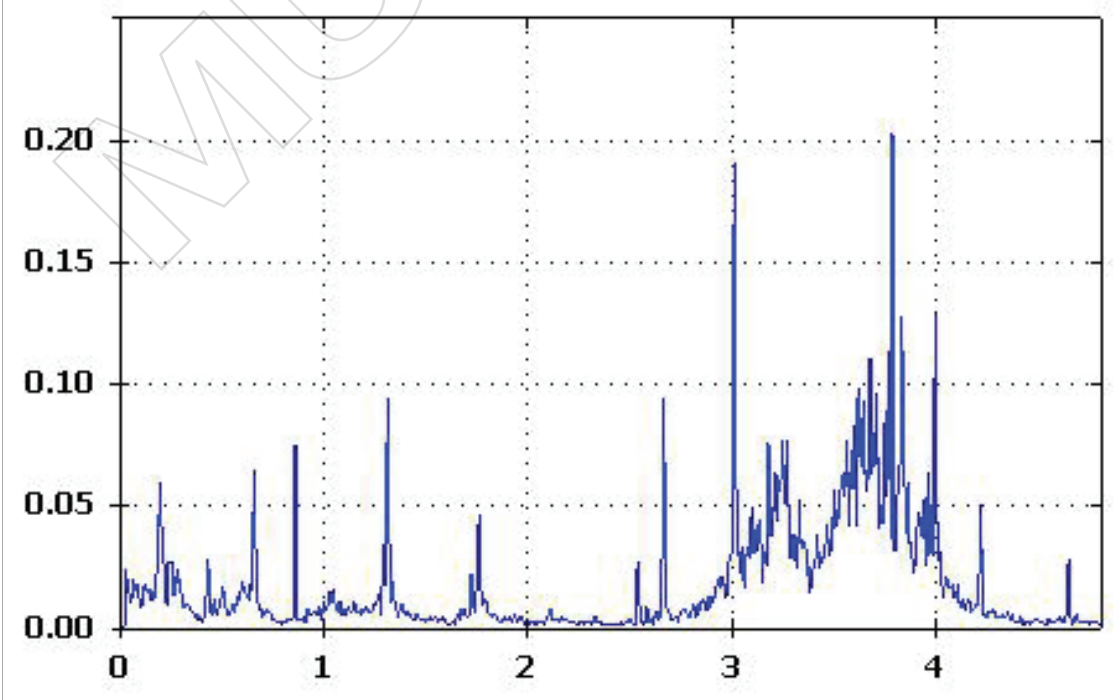

Fault description : Pump Free End Ball Bearing Wear

Fault severity : Moderate (31)

Cited peak number	Bearing	Axis	Vibration amplitude	Order	Range
Cited peak1	Location4	Axial	2.36 mm/sec	9.48	High
Cited peak2	Location4	Tangential	1.44 mm/sec	9.31	High
Cited peak3	Location4	Axial	0.46 mm/sec	10.8	High
Cited peak4	Location4	Tangential	0.25 mm/sec	5.32	High
Cited peak5	Location4	Radial	0.20 mm/sec	3.79	Low
Cited peak6	Location4	Radial	0.20 mm/sec	10.3	High
Cited peak7	Location4	Radial	0.18 mm/sec	11.6	High

Fault description : Pump Drive End Ball Bearing Wear

Fault severity : Moderate (30)

Cited peak number	Bearing	Axis	Vibration amplitude	Order	Range
Cited peak1	Location3	Axial	1.06 mm/sec	6.57	High
Cited peak2	Location3	Axial	0.91 mm/sec	9.55	High
Cited peak3	Location3	Radial	0.88 mm/sec	6.8	High
Cited peak4	Location3	Tangential	0.76 mm/sec	10.7	High
Cited peak5	Location3	Radial	0.72 mm/sec	6.45	High
Cited peak6	Location3	Tangential	0.34 mm/sec	5.34	High
Cited peak7	Location3	Radial	0.24 mm/sec	3.65	Low

Fault description : Pump Drive End Looseness Or Bearing Clearance Problem

Fault severity : Slight (8)

Cited peak number	Bearing	Axis	Vibration amplitude	Order	Range
Cited peak1	Location3	Axial	1.08 mm/sec	7	High
Cited peak2	Location3	Axial	1.05 mm/sec	6	High
Cited peak3	Location3	Radial	0.78 mm/sec	6	High
Cited peak4	Location3	Radial	0.70 mm/sec	7	High
Cited peak5	Location3	Tangential	0.34 mm/sec	6	High
Cited peak6	Location3	Axial	0.23 mm/sec	9	High
Cited peak7	Location3	Tangential	0.22 mm/sec	4.67	Low
Cited peak8	Location3	Tangential	0.22 mm/sec	8	High
Cited peak9	Location3	Axial	0.21 mm/sec	4.67	Low

Machine Setup Details

Machine Setup Name : USCC

Setup Field	Input
Motor type	AC
AC motor with VFD	Yes
Speed in RPM	717
Nominal hp	50
Motor mounted	Horizontal
Motor has	Roller bearing
Motor detached from drive train	No
Motor close-coupled	No
Coupling between motor and next component	Yes
Next component	Pump
Driven component bearing type	Roller bearing
Pump type	Centrifugal
Impeller is supported by	Overhung
No. of pump vanes or blades [optional]	

Este documento es una muestra de informe de diagnóstico del Fluke 810. El aspecto real del informe depende de los datos capturados y de las imágenes seleccionadas. Para obtener más información, visite www.fluke.com/viewer-software o envíe un mensaje de correo electrónico a vibration@fluke.com.

Fluke. *Manteniendo su mundo en marcha.*

PRÜFTECHNIK Condition Monitoring GmbH
 Oskar-Messter-Str. 19-21
 85737 Ismaning
 Germany
 T + 49 8999616 420
salesupport@pruftechnik.com

©2017 Fluke Corporation. Reservados todos los derechos. Información sujeta a modificación sin previo aviso.
 12/2017 3951929a-spa

No se permite ninguna modificación de este documento sin permiso escrito de Fluke Corporation.